


smartIAQ to Babel Buster BB3-7101 Connection Wiring Diagram

Notes:

- (1) Signal return required
- (2) Cable shield terminated per wiring standards
- (3) ESD protection depends on a ground suitable for dissipation of static discharge
- (4) These terminals are electrically common on BB3-7101.

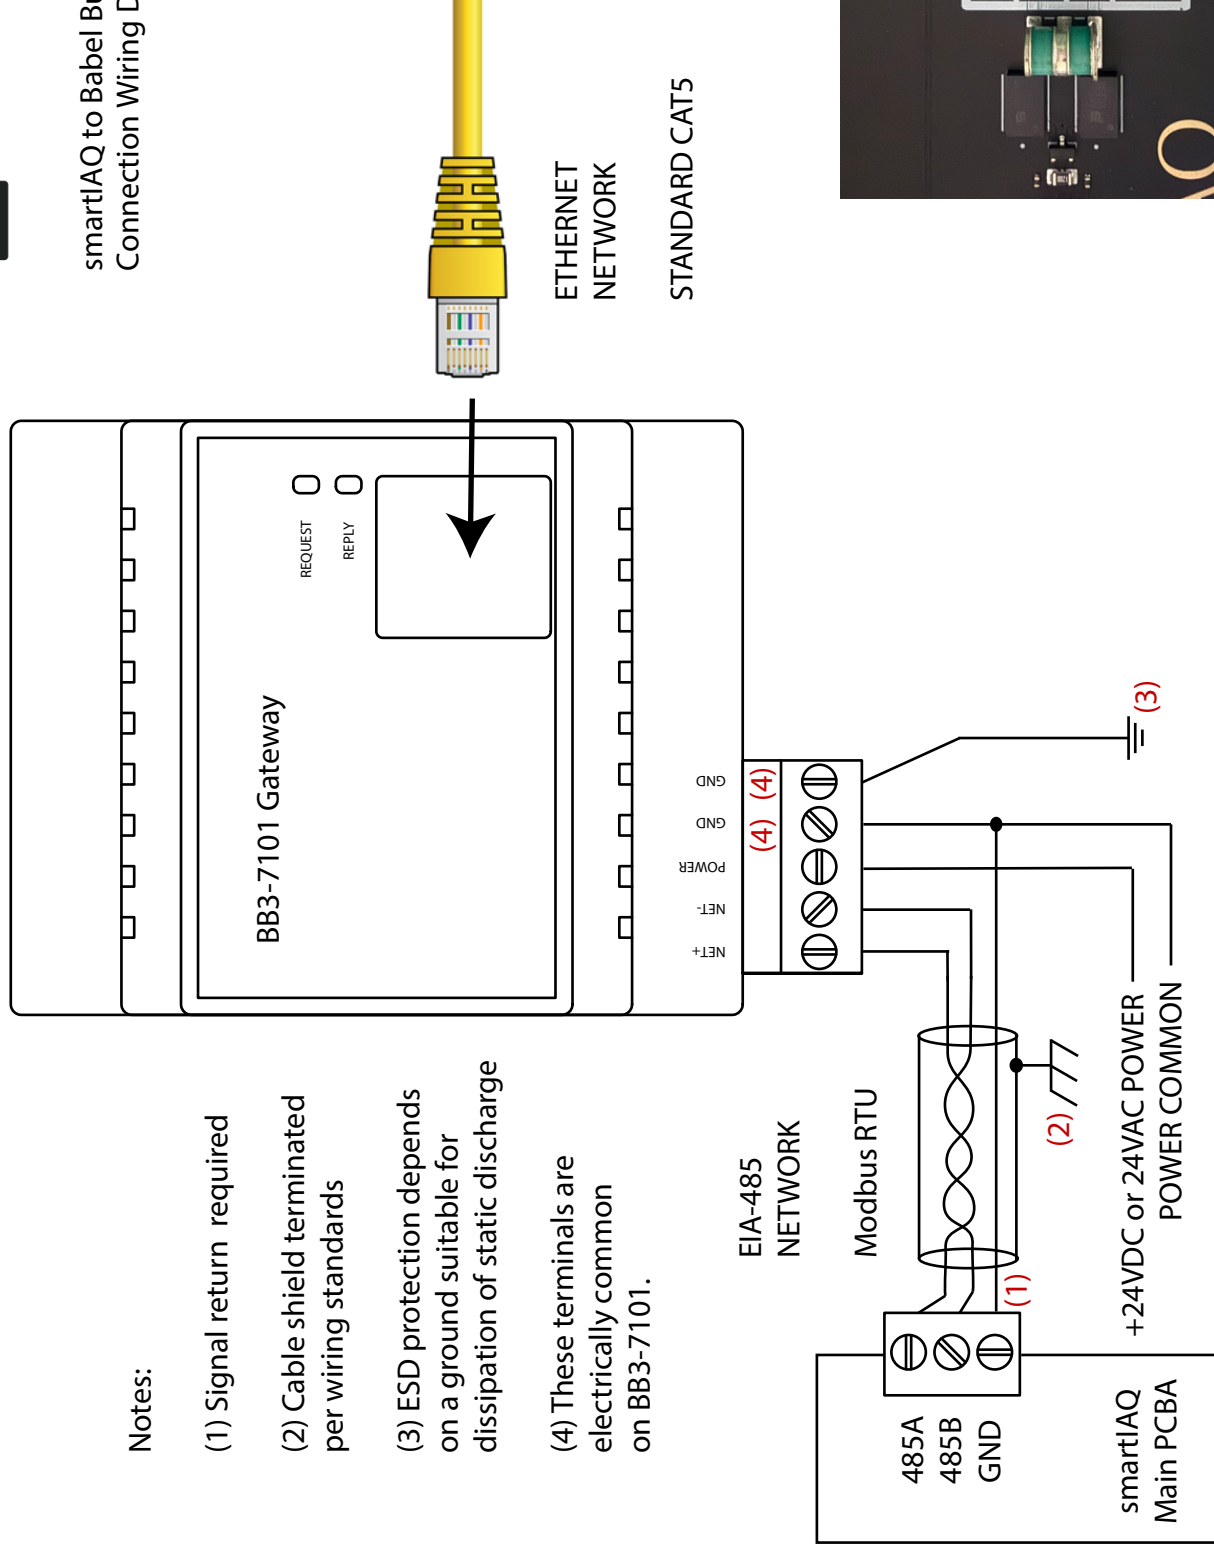

smartIAQ
Main PCBA

