



EFFICACY OF THE GPS-FC48-AC™ AGAINST SARS-COV-2 DELTA VARIANT

PROJECT: GPS – NPBI FC48 – AEROSOL SARS-COV-2 DELTA VARIANT

TECHNOLOGY: Needlepoint Bipolar Ionization (NPBI™)

DEVICE: GPS-FC48-AC™

CAP LIC NO: 8860298

CLIA LIC NO: 05D0955926

STATE ID: CLF 00324630

CHALLENGE ORGANISM:

SARS-COV-2 DELTA VARIANT

Medical Director:

Dana Yee, M.D.

Study Completion Date:

03/07/22

Testing Facility:

Innovative Bioanalysis, Inc.

3188 Airway Ave Suite D

Costa Mesa CA, 92626

www.InnovativeBioanalysis.com

Email: info@innovativeBioanalysis.com

Laboratory Project Number:

1189D



Table of Contents

EFFICACY OF THE GPS-FC48-AC™ AGAINST SARS-COV-2 DELTA VARIANT	1
Efficacy Study Summary	3
Study Report	4
Study Title:	4
Sponsor:	4
Test Facility:	4
Technology Tested:.....	4
Device Testing:	4
Study Dates:	4
Study Objective:	4
Test Method:.....	4
Test System Strains:.....	5
Study Materials and Equipment:.....	7
Control Protocol:	9
Test Procedures:.....	10
Study Results:.....	12
Conclusion.....	13
Disclaimer	14



Efficacy Study Summary

Study Title	EFFICACY OF THE GPS-FC48-AC™ AGAINST SARS-COV-2 DELTA VARIANT
Laboratory Project #	1189D
Guideline:	GCLP, modified ISO, and BSL-3 standards were used.
Testing Facility	Innovative Bioanalysis, Inc.
GLP Compliance	All internal SOPs and processes follow GCLP guidelines and recommendations.
Test Substance	SARS-CoV-2 Delta Variant
Description	Per the manufacturer, the GPS-FC48-AC™ device housing NPBI™ technology is commercially available and designed to be installed in an HVAC system to reduce the concentration of certain bacteria and viruses while operational. Testing was conducted on the device to evaluate the effectiveness of the NPBI™ technology in reducing aerosolized SARS-CoV-2 Delta Variant.
Test Conditions	The test was conducted in a sealed 20'x8'x8' chamber that complied with BSL-3 standards and was inspected for leaks before use. The temperature during testing was 73 ±1°F, with a relative humidity between 38-39%. A 10mL of 2.47 x 10 ⁷ TCID50/mL of SARS-CoV-2 Delta Variant in suspension media was nebulized into the room with mixing fans before collection. Air sample collections occurred at 0, 15, 30, 45, and 60 minutes of exposure and were tested in triplicate. Ion concentrations were measured in the chamber during a dry run test prior to viral challenges.
Test Results	The GPS-FC48-AC™ device housing NPBI™ technology consistently reduced active SARS-CoV-2 Delta Variant at each time point faster than natural loss rates. With an average of 24,070 negative ions/cm ³ concentration, the GPS-FC48-AC™ decreased a starting concentration of 2.47 x 10 ⁷ TCID50/mL SARS-CoV-2 Delta Variant to an average of 1.75 x 10 ⁷ TCID50/mL. Increased exposure time resulted in a higher observed reduction in recoverable active SARS-CoV-2 Delta, with an average of 1.57 x 10 ³ TCID50/mL recovered after 60 minutes.
Control Results	Control tests were conducted in triplicate without the device operational, and samples were taken at the corresponding time points used for the challenge. The results for the controls were plotted to show a natural rate of loss over 60 minutes and were used to assess the NPBI™ technology's ability to reduce SARS-CoV-2 Delta Variant in air.
Conclusion	The NPBI™ technology demonstrated the overall capability to reduce aerosolized SARS-CoV-2 Delta Variant viruses at each time point faster than the natural viability loss rates. After 60 minutes of operation, a 99.994% gross reduction in active SARS-CoV-2 Delta Variant in the air was achieved with the device producing an average of 24,070 negative ions/cm ³ compared to a 67.51% loss without the device.



Study Report

Study Title: EFFICACY OF THE GPS-FC48-AC™ AGAINST SARS-COV-2 DELTA VARIANT

Sponsor: Global Plasma Solutions (dba GPS Air)

Test Facility: Innovative Bioanalysis, Inc. 3188 Airway Ave Suite D, Costa Mesa, CA 92626

Technology Tested: NPBI™

Device Testing: GPS FC48-AC™

Study Dates:

Study Report Date: 03/09/2022

Experimental Start Date: 12/07/2021

Experimental End Date: 12/09/2021

Study Completion Date: 03/07/2022

Study Objective:

The GPS-FC48-AC™ containing NPBI™ technology was provided by Global Plasma Solutions for testing to evaluate the efficacy of the device against an aerosolized virus, SARS-CoV-2 Delta Variant. The following test was to determine what reductions were possible under controlled conditions.

Test Method:

Bioaerosol Generation:

Nebulization occurred using a Blaustein Atomizing Module (BLAM), as shown in Figure 1, with a pre-set PSI and computer-controlled liquid delivery system. Before testing, the nebulizer was checked for proper functionality by nebulizing the FBS solution without the test virus present to confirm average particle size distribution. The nebulizer was filled with 2.47×10^7 TCID50/mL of SARS-CoV-2 Delta variant in viral suspension media and nebulized at a flow rate of 1mL/min with untreated local atmospheric air. After nebulization, the nebulizer's remaining viral stock volume was weighed to confirm roughly the same amount was nebulized during each run. Bioaerosol procedures for the controls and viral challenges were performed in the same manner with corresponding time points and collection rates.



Figure 1: BLAM Nebulizer

INNOVATIVE BIOANALYSIS

creating solutions | getting results

Bioaerosol Sampling:

This study used four probes for air sampling, each connected to a calibrated Gilian 10i vacuum device and set at a standard flow of 5.02L/min with a 0.20% tolerance. Sample collection volumes were set to 10-minute draws per time point, which allowed for approximately 50 liters of air collection per collection port. The air sampler operated with a removable sealed cassette and was manually removed after each sampling time point. Cassettes had a delicate internal filtration disc (Fig. 2) to collect virus samples, which was moistened with a virus suspension media to aid in the collection and viability. Filtration discs from Zefon International, Lot# 28144, were used for testing. At each time point, all the sample discs were pooled into one collection tube to provide an average across the four sampling locations.



Figure 2: Sensidyne 37mm directional air flow sampler cassette.

Test System Strains: SARS-CoV-2 Lineage B.1.617.2; Delta Variant

The following reagent was obtained through BEI Resources, NIAID, NIH: SARS-Related Coronavirus 2, Isolate hCoV-19/USA/PHC658/2021 (Lineage B.1.617.2; Delta Variant), NR-55611, contributed by Dr. Richard Webby and Dr. Anami Patel.



TCID50 Procedure:

Materials and Equipment:

- Certified Biological Safety Cabinet
- Micropipette and sterile disposable aerosol resistant tips—20uL, 200uL, 1000uL
- Inverted Microscope
- Tubes for dilution
- Hemocytometer with coverslip
- Cell media for infection
- Growth media appropriate for the cell line
- 0.4% Trypan Blue Solution
- Lint-free wipes saturated with 70% isopropyl alcohol
- CO₂ Incubator set at 37°C or 34°C, or other temperature as indicated

Procedure:

1. One day before infection, prepare 96 well dishes by seeding each well with Vero E6 cells in DMEM plus fetal bovine serum, 4mM Glutamine, and antibiotics.
2. On the day of infection, make dilutions of virus samples in PBS.
3. Make a series of dilutions at 1:10 of the original virus sample. Fill the first tube with 2.0mL PBS and the subsequent tubes with 1.8mL.
4. Vortex the viral samples, then transfer 20uL of the virus to the first tube, vortex, and discard tip.
5. With a new tip, serial dilute subsequent tips transferring 200uL.

Additions of virus dilutions to cells:

1. Label the lid of a 96-well dish by drawing grid lines to delineate quadruplicates, number each grid to correspond to the virus sample, and label the rows of the plate for the dilution, which will be plated.
2. Include four(4) negative wells on each plate which will not be infected.
3. Remove all but 0.1mL of media from each well by vacuum aspiration.
4. Starting from the most dilute sample, add 0.1mL of virus dilution to each of the quadruplicate wells for that dilution.
5. Infect four wells per dilution, working backward.
6. Allow the virus to absorb to the cells at 37°C for 2 hours.
7. After absorption, remove the virus inoculum. Start with the most dilute and work backward.
8. Add 0.5mL infection medium to each well, being careful not to touch the wells with the pipette.
9. Place plates at 37°C and monitor CPE using the inverted microscope over a period of 1 to 4 weeks.
10. Record the number of positive and negative wells.

INNOVATIVE BI•ANALYSIS

creating solutions | getting results

Study Materials and Equipment:

Equipment Overview: The GPS-FC48-AC™ device housing NPBI™ technology (Fig. 3) arrived at the laboratory pre-packaged from the manufacturer and was inspected for damage upon arrival. Due to the closed design, no assessment was conducted on the inner components of the ionizer. Before testing, the GPS-FC48-AC™ was powered on and operated for 1 hour in a dry run to confirm correct operations. Two Alpha Lab AIC2 ion polarity meters confirmed ion generation, as shown in Figure 5. Ion concentrations were measured at one point located in the center of the room across from the device's location. Average device ion concentration was recorded at 15,790 positive ions/cm³ and 24,070 negative ions/cm³ with the manufacturer's pre-set airflow. It should be noted that due to the nature of ions, there were fluctuations in concentrations around the entire room.

MANUFACTURER: Global Plasma Solutions

MODEL: GPS-FC48-AC™

TECHNOLOGY: NPBI™

SIZE: 11.1" x 1.84" x 3.52"

SERIAL #: N/A



Figure 3. The GPS-FC48-AC™ as tested.

Testing Layout:

Testing was conducted in a sealed 20'x8'x8' chamber per Biosafety Level 3 (BSL3) standards. The room had a displacement volume of 1,280 ft³ (36,245.56 L) of air. The room remained closed to prevent any air from entering and leaving the room during testing. A nebulizing port connected to a programmable compressor system was located in the center of the 20-ft wall protruding 24-inches from the wall opposite the door. At each chamber corner, low-volume mixing fans (approx. 30 cfm each) were positioned at 45-degree angles to ensure homogenous mixing of bioaerosol concentrations when nebulized into the chamber. For air sample testing, the room was equipped with four probes positioned along the centerline of the room and protruded down from the ceiling 24-inches. The device was placed in the room's centerline and mounted on a movable scaffolding against the wall at an elevated position six feet above the ground, as depicted in Figure 4. A variable-speed fan was placed behind the GPS-FC48-AC™ to create the necessary airflow to produce the required concentration of negative ions. The chamber was visually inspected, pressure tested, and all internal lab systems and equipment were reviewed before testing. Furthermore, ion measurements were measured again before testing to confirm consistent reading.

INNOVATIVE BIOANALYSIS

creating solutions | getting results

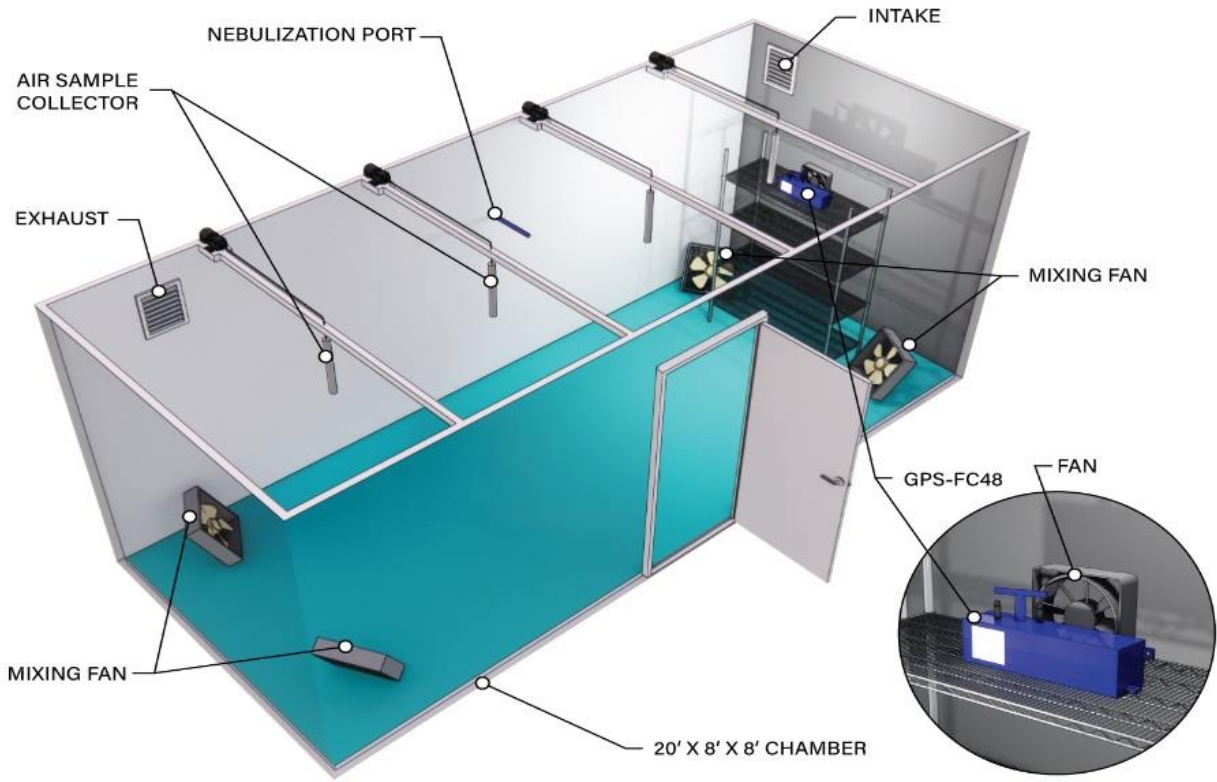


Figure 4. Room layout for control and experimental testing.

INNOVATIVE BI_•ANALYSIS

creating solutions | getting results

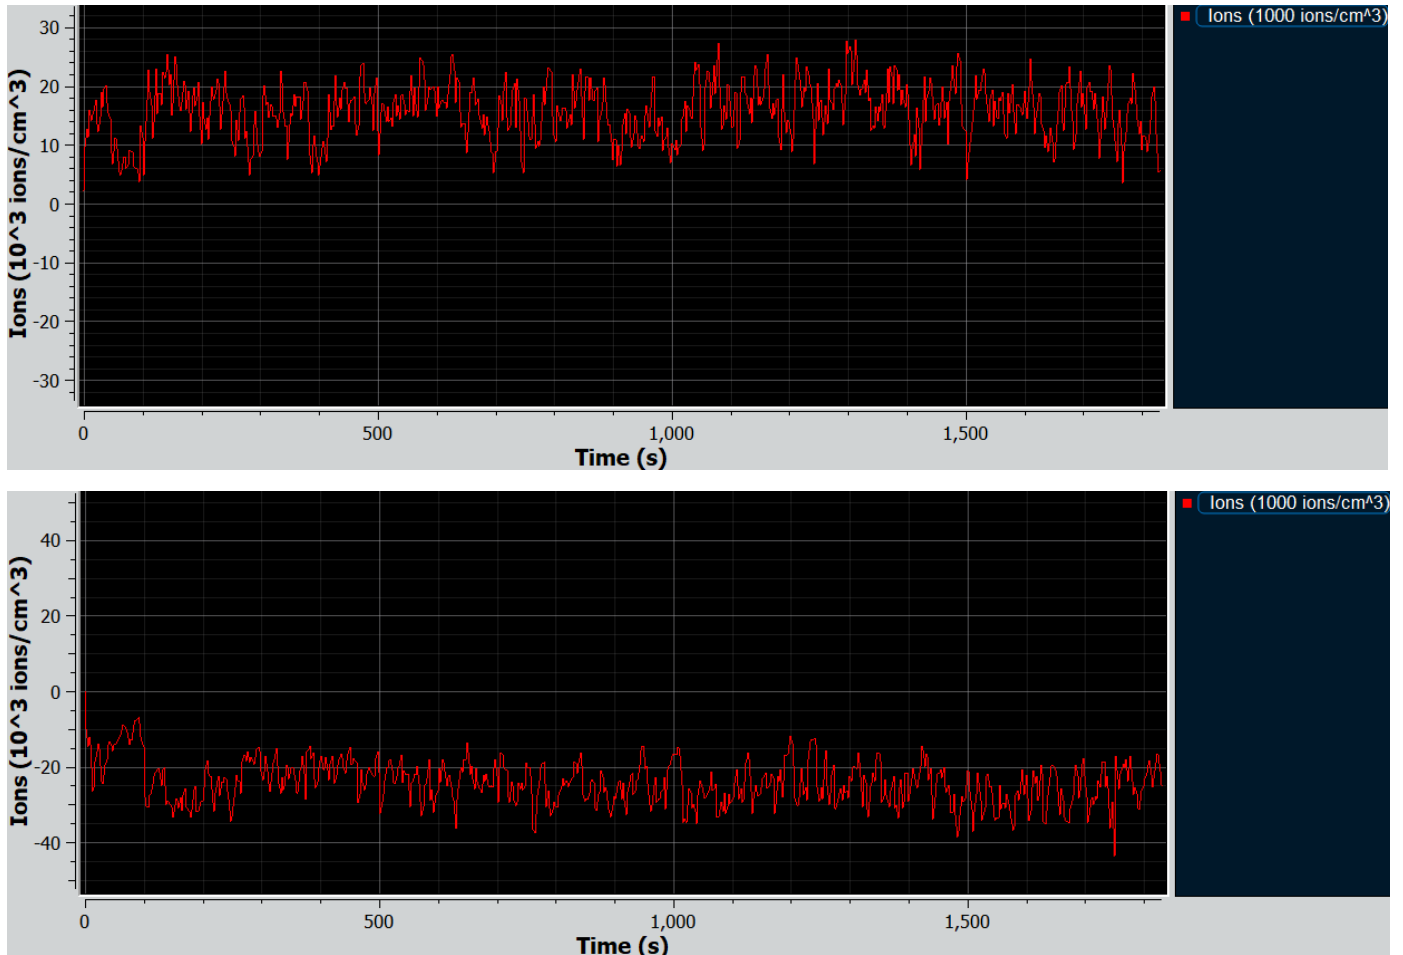


Figure 5. Positive (top) and negative (bottom) ion concentration readings during the dry run. Average ion concentration was measured at 15,790 positive ions/cm³ and 24,070 negative ions/cm³.

Control Protocol:

To accurately assess the GPS-FC48-AC™ device housing NPBI™ technology, a control was conducted in triplicate without the device operating in the testing chamber. The samples were taken in the same manner and at the corresponding time points used for the challenge trial to serve as a comparative baseline to assess viral reduction when the device was operating.



Test Procedures:

Exposure Conditions:

1. The temperature during all test runs was approximately $73 \pm 1^{\circ}\text{F}$, with 38-39% relative humidity.
2. The device was off during nebulization and turned on upon completion at T-0.
3. Testing time points were as follows, with T equal to minutes: T-0, T-15, T-30, T-45, and T-60.

Experimental Procedures:

1. Before the initial control test and following each trial run, the testing area was decontaminated and prepped per internal procedures.
2. 10 mL of 2.47×10^7 TCID50/mL SARS-CoV-2 Delta Variant viral suspension media was nebulized into the sealed environment via the dissemination port.
3. After nebulization, the GPS-FC48-AC™ device was turned on via remote control.
4. The device was turned off at the pre-determined time points for sample collection.
5. Air sampling collection was set to 10-minute continuous draws at the point of sampling occurring after nebulization ceased.
6. Sample cassettes were manually removed from the collection system and taken to an adjacent biosafety cabinet to be pooled.
7. All samples were sealed after collection and provided to lab staff for analysis after study completion.

Post Decontamination:

After each viral challenge test, the UV system inside the testing chamber was activated for 30 minutes. After 30 minutes of UV exposure, the air filtration system underwent a 30-minute air purge. All test equipment was cleaned with a 70% isopropyl alcohol solution at the end of each day. Collection lines were soaked in a bleach bath mixture for 30 minutes and then rinsed repeatedly with DI water. The nebulizer and vacuum collection pumps were decontaminated with hydrogen peroxide mixtures.



Preparation of The Pathogen

Viral Stock: SARS-CoV-2 Delta Variant (BEI NR-55611)

TEST	SPECIFICATIONS	RESULTS
Identification by Infectivity in Calu-3 Cells		
	Cell rounding and detachment	Cell rounding and detachment
Next-Generation Sequencing (NGS) of Complete Genome Using Illumina® iSeq™ 100 Platform	≥ 98% identity with SARS-CoV-2, hCoV-19/USA/PHC658/2021 depositor sequence	99.99% identity with SARS-CoV-2, hCoV-19/USA/PHC658/2021 depositor sequence
Titer by TCID₅₀ Assay in Calu-3 Cells by Cytopathic Effect	Report Results	6.5 X 10 ⁵ TCID ₅₀ per mL
Sterility (21-Day Incubation)		
Harpo's HTYE Broth, aerobic	No Growth	No Growth
Trypticase Soy Broth, aerobic	No Growth	No Growth
Sabourad Broth, aerobic	No Growth	No Growth
Sheep Blood Agar, aerobic	No Growth	No Growth
Sheep Blood Agar, anaerobic	No Growth	No Growth
Thioglycollate Broth, anaerobic	No Growth	No Growth
DMEM with 10% FBS	No Growth	No Growth
Mycoplasma Contamination		
Agar and Broth Culture	None Detected	None Detected
DNA Detection by PCR of extracted test article nucleic acid	None Detected	None Detected


*The viral titer listed in the Certificate of Analysis represents the titer provided by BEI Resources.

INNOVATIVE BIOANALYSIS

creating solutions | getting results

Study Results:

The graph below displayed recoverable SARS-CoV-2 Delta Variant with and without the GPS-FC48-AC™ device housing NPBI™ technology operating over 60 minutes. The control shows a natural viability loss over time within the chamber under controlled conditions. At an average of 24,070 negative ions/cm³ against SARS-CoV-2 Delta, a starting concentration of 2.47 x 10⁷ TCID50/mL was reduced to 1.80 x 10⁷, 1.75 x 10⁷, 1.70 x 10⁷, and averaging to approximately 1.75 x 10⁷ TCID50/mL at 15 minutes. At 30 minutes, an average 9.59 x 10⁶ TCID50/mL SARS-CoV-2 Delta Variant was recovered, and 3.74 x 10⁶ TCID50/mL after 45 minutes. Within 60 minutes, the GPS-FC48-AC™ device housing NPBI™ technology reduced aerosolized SARS-CoV-2 Delta Variant to 1.57 x 10³ TCID50/mL.

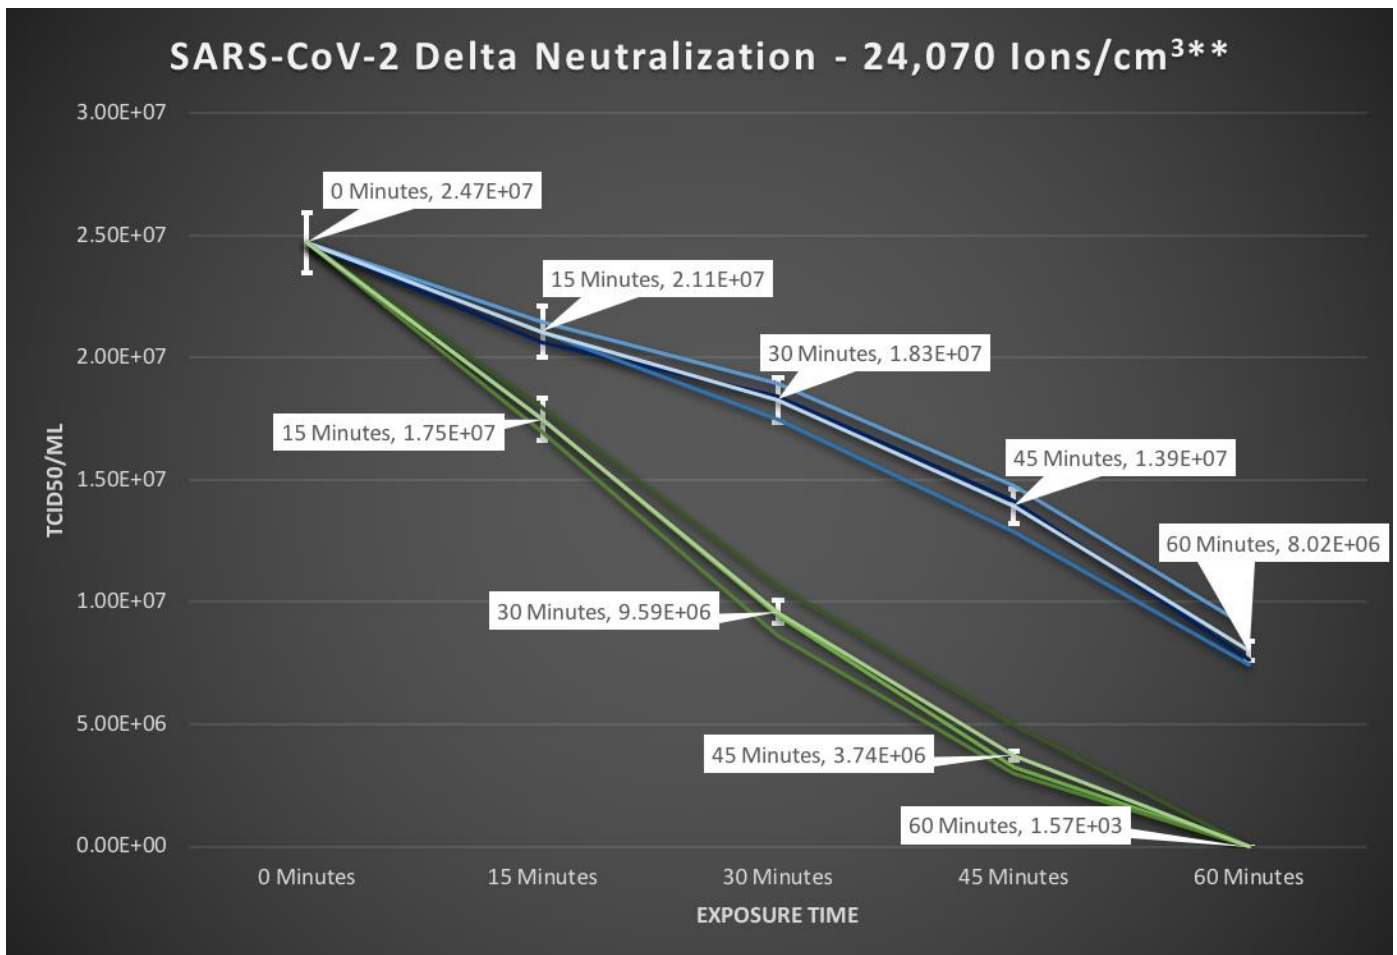

**As it pertains to data represented herein, the percentage error equates to an average of ±5% of the final concentration.



SARS-COV-2 Delta Neutralization					
Time (min)	0	15	30	45	60
Control 1	2.47E+07	2.06E+07	1.84E+07	1.41E+07	7.66E+06
Control 2	2.47E+07	2.11E+07	1.75E+07	1.29E+07	7.43E+06
Control 3	2.47E+07	2.15E+07	1.90E+07	1.48E+07	8.96E+06
3 Control Average	2.47E+07	2.11E+07	1.83E+07	1.39E+07	8.02E+06
% Reduction - Gross Control Avg.		-14.69%	-25.92%	-43.62%	-67.52%
Experiment 1	2.47E+07	1.80E+07	1.07E+07	4.98E+06	1.27E+03
Experiment 2	2.47E+07	1.75E+07	9.47E+06	3.27E+06	2.49E+03
Experiment 3	2.47E+07	1.70E+07	8.65E+06	2.97E+06	9.60E+02
3 Experiment Average	2.47E+07	1.75E+07	9.59E+06	3.74E+06	1.57E+03
% Reduction - Gross Experiment Avg.		-29.23%	-61.15%	-84.85%	-99.99%
% Net Reduction Avg.		-17.04%	-47.56%	-73.12%	-99.98%

Conclusion

The GPS-FC48-AC™ device housing NPBI™ technology demonstrated the ability to consistently reduce aerosolized SARS-CoV-2 Delta variants in a controlled environment with negative ion concentration measured at 24,070 negative ions/cm³ from a central point in the room. The device displayed the following gross reductions at each time point: 29.22% gross reduction at 15 minutes, 61.14% at 30 minutes, 84.84% at 45 minutes, and a 99.994% gross reduction after 60 minutes of exposure. Ion concentrations were measured in the chamber during a dry run test prior to viral challenges.

When aerosolizing pathogens and collecting said pathogens, some variables cannot be fully accounted for, namely, placement of pathogen, collection volume, collection points, drop rate, surface saturation, viral destruction on collection, viral destruction on aerosolization, and possibly others. Every effort was made to address these constraints with the design and execution of the trials. And these efforts are reflected in the meaningful recovery of virus in the control test.

Considering variables, there was a measurable amount of reduction achieved by the GPS-FC48-AC™ device housing NPBI™ technology at each time point (T-15, T-30, T-45, and T-60). The decline of SARS-CoV-2 Delta Variant in the air was consistent with the manufacturer's claims that the device can decrease the concentration of active pathogens in the air. Overall, the device successfully reduced SARS-CoV-2 Delta Variant from the air under controlled conditions within the parameters of the test environment.

INNOVATIVE BIOANALYSIS

creating solutions | getting results

DocuSigned by:

Dr. Dana Yee M.D.

52F0012FC10C43F...

7/12/2022

Dana Yee M.D

Date

Clinical Pathologist and Medical Director, Innovative Bioanalysis, Inc.

DocuSigned by:

Sam Kabbani

8B4B282DE4B34A3

7/12/2022

Sam Kabbani, MS, BS, MT(ASCP), CLS

Date

Chief Scientific Officer, Innovative Bioanalysis, Inc.

DocuSigned by:

Albert Brockman

42751B72F2FE40A

7/12/2022

Albert Brockman

Date

Chief Biosafety Officer, Innovative Bioanalysis, Inc.

DocuSigned by:

Kevin Noble

5DF2797BAA78421

7/12/2022

Kevin Noble

Date

Laboratory Director, Innovative Bioanalysis, Inc.

[Disclaimer](#)

The Innovative Bioanalysis, Inc. ("Innovative Bioanalysis") laboratory is not certified or licensed by the United States Environmental Protection Agency and makes no equipment emissions claims pertaining to ozone, hydrogen peroxide gas, reactive oxygen species, volatile organic compounds, or byproduct of any device. Innovative Bioanalysis, Inc. makes no claims to the overall efficacy of any device. The experiment results are solely applicable to the device used in the trial. The results are only representative of the experiment design described in this report. Innovative Bioanalysis, Inc. focuses heavily of variable mitigation as it pertains to our experiments and uses several proprietary methods of culturing pathogens and recovering experiment samples. Tests conducted in the same manner with attention to all experimental variables should come within a margin of error to the results stated within this report. Innovative Bioanalysis, Inc. makes no claims to third parties and takes no responsibility for any consequences arising out of the use of, or reliance on, the experiment results by third parties.